

The **BA488CF Fieldbus Display** is an intrinsically safe instrument that can display up to eight fieldbus process variables. Nine selectable standard screen formats contain one, two, three or four variables, with units of measurement, tag descriptions and bargraphs on some screens. The use of standard screens simplifies commissioning, but if required dedicated screens tailored to an individual application can be constructed.

**FOUNDATION fieldbus™ and Profibus PA** versions of the BA488CF are available and have been registered by both organisations. The FOUNDATION fieldbus™ version now has selectable function blocks allowing use with most popular system hosts. Configuration files may be downloaded from the appropriate Fieldbus Foundation™ or Profibus sites, or from [www.beka.co.uk](http://www.beka.co.uk).

**Powered by the fieldbus** the BA488CF only requires a 2-wire connection, no additional power supply Zener barriers or galvanic isolators are required. The high contrast 86 x 45mm liquid crystal display incorporates a green backlight that is also powered from the fieldbus enabling the display to be read in all lighting conditions from full sunlight to total darkness.


**Simple commissioning** results from the use of standard display formats. Apart from loading the BA488CF configuration files onto the system host and selecting the fieldbus variables to be displayed, no programming is required. Configuration of the BA488CF Fieldbus Display is performed via the fieldbus and the instrument front panel push buttons.

**ATEX, FM & IECEx intrinsic safety certification** allows the BA488CF to be installed in gas hazardous areas worldwide. The two fieldbus terminals comply with the Fieldbus Intrinsic Safety Concept (FISCO) simplifying system design and documentation, although connection to non-FISCO intrinsically safe segments is possible using the entity concept. This allows a BA488CF to be directly connected to almost any hazardous

fieldbus providing the segment can supply the 25mA consumed by the display.

**Six optional alarm outputs** may be linked to any of the displayed variables. Each isolated single pole solid state output may be conditioned as a combined high and low alarm, or as just a high or low alarm. All the outputs comply with the requirements for *simple apparatus*, which permits them to switch any certified intrinsically safe load such as an intrinsically safe sounder, lamp or solenoid valve.

**Custom display screens** dedicated to a specific application may be created by writing to the transducer block parameters. Custom designed displays can contain text in five different font sizes plus lines, boxes, bargraphs, simple graphics and fieldbus process variables. Free programming utilities to assist with screen development are available via the BEKA web site.



Typical custom display

**The six push buttons** on the front of the instrument may be used for returning operator acknowledgments or controls by reading a transducer block parameter. If larger industrial switches are required for these acknowledgements, up to six external push buttons may be connected to the BA488CF. When the external switches are activated, the front panel push buttons may be disabled or operated in parallel with the external switches.

**Comprehensive documentation** includes FOUNDATION fieldbus™ and Profibus Interface Guides and a Programming Guide that explains how to create custom display screens.

**For field mounting applications** see the BA484DF datasheet. This instrument has a similar electrical specification but is housed in a robust IP66 GRP enclosure suitable for external mounting.

# BA488CF

## Fieldbus display 8 variables

*Intrinsically safe for use in all gas hazardous areas*

- ◆ FOUNDATION fieldbus™ & Profibus PA models
- ◆ Compatible with most system hosts
- ◆ High contrast display with backlight
- ◆ Intrinsically safe ATEX, FM & IECEx certification FISCO compliant
- ◆ Six operator push buttons & six optional alarm outputs
- ◆ IP66 front panel
- ◆ 3 year guarantee




# BEKA associates

BEKA associates Ltd. Old Charlton Rd. Hitchin, Hertfordshire, SG5 2DA, U.K. Tel. (01462) 438301 Fax (01462) 453971 e-mail [sales@beka.co.uk](mailto:sales@beka.co.uk) [www.beka.co.uk](http://www.beka.co.uk)

## SPECIFICATION

<b>Display</b>	
Type	120 x 64 pixel liquid crystal
Size	86.5mm x 45mm
Backlight	Powered from fieldbus
Screens	
Standard format	1, 2, 3 or 4 variables plus bargraph can include: units of measurement tag information
Custom format	See Programming Guide
Characters	ASCII character set, 5 font sizes each with 4 computer definable soft characters.
Hidden screen	May be written to at any time and displayed when required.
<b>Controls</b>	
Front panel	Six push buttons which select the displayed screen. May be used for returning operator acknowledgements by reading transducer block parameters.
External switches	Control may be transferred to six external switches; front panel buttons may be inhibited or operated in parallel.
Switch cable	5m max length.
<b>Fieldbus communication</b>	
Voltage	9 to 17.5V (limited by intrinsic safety parameters)
Current	25mA
Compliant with Protocol	IEC61158—2 Clauses 11 and 22
Function blocks	FOUNDATION fieldbus™ or Profibus PA
FOUNDATION fieldbus™	1 x MAO (Multiple Analogue Output)
or Profibus PA	2 x IS (Input Selector)
	8 x AO (Analogue Output)
	Selectable on-site
<b>Intrinsic safety</b>	
<b>Europe ATEX</b>	
Standard Code	EN50020:2002
	Group II Category 1G
	EEx ia IIC T4
Cert. No.	ITS04ATEX22779
Intrinsic safety parameters	$U_i = 17.5V$ $I_i = 380mA$ $P_i = 5.32W$
	FISCO compliant
Location	Zone 0, 1 or 2
<b>USA FM</b>	
Standard Code	3610 Entity
	CL I; Div 1; GP A, B, C & D
	T4 @ 60°C
File No	3022546
Standard Code	3611 Nonincendive
	CL I; Div 2; GP A, B, C & D
	T4 @ 60°C
File No	3022546
<b>International IECEx</b>	
Standard Code	IEC60079-11:1999
Cert. No.	Ex ia IIC T4 Ta = -40 to 60°C
	IECEx ITS 05.0007
<b>Environmental</b>	
Operating temp	-20 to +60°C (certified for use at -40°C)
Storage temp	-40 to 85°C
Humidity	To 95% @ 40°C
Enclosure	Front IP66, rear IP20
EMC	In accordance with EU Directive 89/336/EEC
Immunity	BS EN 61326:1998
	Operates normally with conducted 3Vrms interference between 0.15kHz and 80MHz, or radiated 10V/m interference between 80MHz and 1GHz.
Emissions	CISPR 16-1/2 Class A
<b>Mechanical</b>	
Terminals	Removable with screw clamp for 0.5 to 1.5mm <sup>2</sup> cable.
Weight	0.7kg
<b>Accessories</b>	
Alarms	Six galvanically isolated outputs which may be linked to displayed variables. Configurable as: combined high and low alarm high or low alarm


## DIMENSIONS (mm)

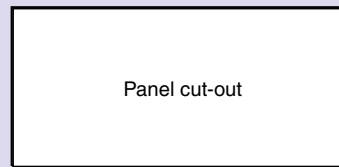


### Recommended panel cut-out

DIN 43 700  
138.0 +1.0/-0.0 x 68.0 +0.7/-0.0

To achieve an IP65 seal between the instrument and the panel  
136.0 +0.5/-0.0 x 66.2 +0.5/-0.0  
Four panel mounting clips must be used

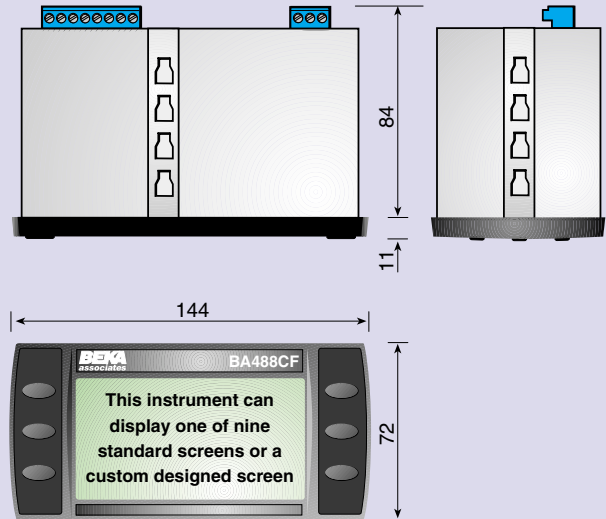

## TERMINAL CONNECTIONS

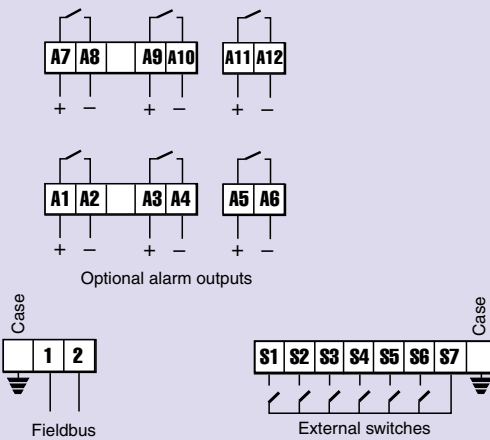

Contacts	Isolated single pole solid state switch certified as simple apparatus. Ron less than 5Ω + 0.7V Roff greater than 1MΩ
Intrinsic safety parameters	$U_i = 28Vdc$ $I_i = 200mA$ $P_i = 0.84W$
Tag number	Thermally printed strip on rear of instrument.
Programming guide	May be downloaded from <a href="http://www.beka.co.uk">www.beka.co.uk</a>
Fieldbus interface guides	May be downloaded from <a href="http://www.beka.co.uk">www.beka.co.uk</a>

## HOW TO ORDER

Model number	<b>Please specify</b> BA488CF
Type of fieldbus	FOUNDATION fieldbus™ or Profibus PA
<b>Accessories</b>	<b>Please specify if required</b>
Six alarms	Alarms
Tag strip	Legend