


Iss	Date	Drn	Modifcation	No	Cl	Ckd
1	2.92	ACH				

MEASUREMENT TECHNOLOGY LTD
Luton, England
Copyright Reserved - Written Permission
to Copy Should be Obtained

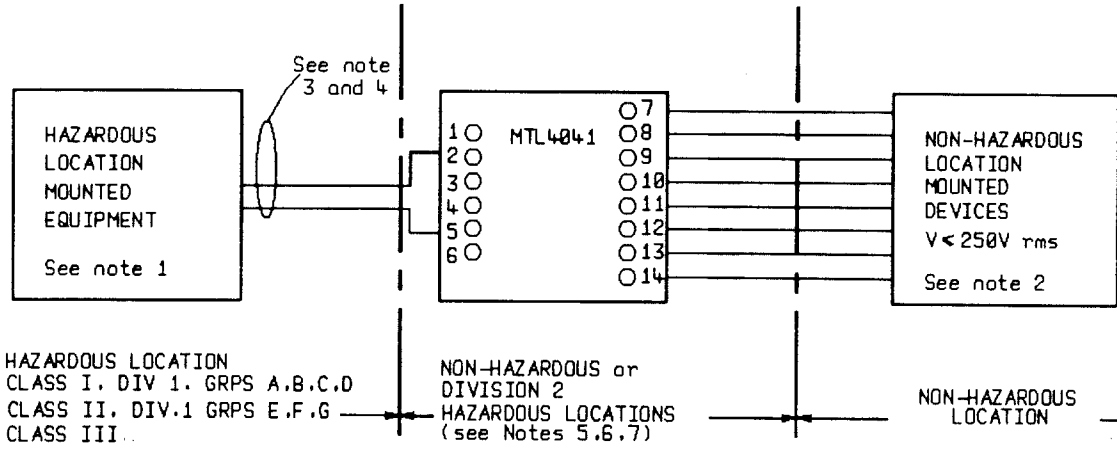

Note 1 The Hazardous Location equipment may be switches or thermocouples. Other apparatus such as RTDs, LEDs and non-inductive resistors may be used if the autoignition temperature of the hazardous location is greater than T4 (275°F or 135°C). Certified devices with the correct Entity Concept Parameters may also be used.

Note 2 The Non-Hazardous Location (or Control Room) equipment must not generate or use more than 250 volts r.m.s.

Note 3 For guidance on the installation see ANSI/ISA RP12.6.

Note 4 Entity Concept Parameters for terminals 2 and 5 are as follows.

$$V_{oc} \leq 28V \quad I_{sc} \leq 93mA.$$

Groups A and B	$Ca \leq 0.13\mu F$	$La \leq 4.2mH$
Groups C and E	$Ca \leq 0.39\mu F$	$La \leq 12.6mH$
Groups D, F and G	$Ca \leq 1.04\mu F$	$La \leq 33.6mH$

Note 5 The MTL4041 is Associated Apparatus and when mounted in the appropriate enclosure (See notes 6 and 7) is suitable for the following areas:-

- Non-Hazardous Locations
- Class I, Division 2, Groups A, B, C, and D Hazardous Locations
- Class II, Division 2, Groups F and G Hazardous Locations
- Class III, Division 2 Hazardous Locations

System Certificate No:		Scale
Certifying Authority: Factory Mutual		Sheet 1 of 2
Title Installation Drawing for the MTL4041		Drg. No. SCI-320

Note 6 Associated Apparatus must be installed in accordance with the National Electrical Code in an enclosure meeting the requirements of ANSI/ISA-S82.

Note 7 Use FMRC Approved or NRTL Listed dust-ignition proof enclosure(s) appropriate for environmental protection in Class II, Division 2, Groups F and G; Class III Divisions 2 Hazardous Locations.

Note 8 For use in Division 2 Hazardous Locations, the MTL4041 must be installed in Factory Mutual Research Corporation Approved Backplanes.

When the MTL4041 is installed in Division 2 Hazardous Locations, a warning label must be prominently affixed near the unit(s) which warns that the MTL4041 must not be removed or inserted unless the area is known to be non-hazardous.

Iss	Date	Drn	Modification	No	Cl	Ckd
1	2.92	ACH				
<input checked="" type="checkbox"/> MEASUREMENT TECHNOLOGY LTD Luton, England Copyright Reserved - Written Permission to Copy Should be Obtained						
Iss	Date	Drn	Modification	No	Cl	Ckd

System Certificate No:	Scale
Certifying Authority: Factory Mutual	Sheet 2 of 2
Title Installation Drawing for the MTL4041	Drg. No. SCI-320