


Iss	1	1.95	ACM	
Date				
Drn				
Modification				
No				
Cl				
Ckd				

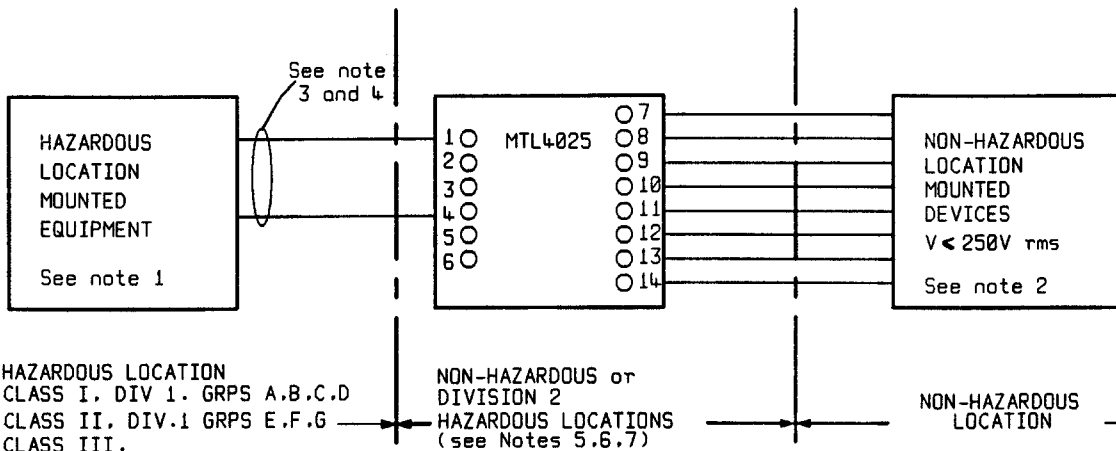

**Note 1** The Hazardous Location equipment may be switches or thermocouples. Other apparatus such as RTD's, LEDs and non-inductive resistors may also be used if the autoignition temperatures of the hazardous location is greater than T4 (275°F or 135°C). Certified devices with the correct Entity Concept Parameters may also be used.

**Note 2** The Non-Hazardous Location (or Control Room) equipment must not generate or use more than 250 volts r.m.s.

**Note 3** For guidance on the installation see ANSI/ISA RP12.6.

**Note 4** Entity Concept Parameters for terminals 1 and 4 of the MTL4025 are as follows.

$$V_{oc} \leq 25V \quad I_{sc} \leq 93mA \quad (\text{All Groups}).$$

Groups A and B	$C_a \leq 0.17\mu F$	$L_a \leq 4.2mH$
Groups C and E	$C_a \leq 0.51\mu F$	$L_a \leq 12.6mH$
Groups D,F and G	$C_a \leq 1.36\mu F$	$L_a \leq 33.6mH$

**Note 5** The MTL4025 is Associated and when mounted in the appropriate enclosure (See notes 6 and 7) is suitable for installation in the following areas:-

- Non-Hazardous Locations
- Class I, Division 2, Groups A,B,C and D Hazardous Locations
- Class II, Division 2, Groups F and G Hazardous Locations
- Class III, Division 2, Hazardous Locations

System Certificate No:	Scale
Certifying Authority: Factory Mutual	Sheet 1 of 2
Title Installation Drawing for the MTL4025	Drg. No. SCI-500

MEASUREMENT TECHNOLOGY LTD  
Luton, England  
Copyright Reserved - Written Permission to Copy Should be Obtained

No	CI	Ckd
Modification		
Iss	Date	Drn
1	1.95	ACH
MEASUREMENT TECHNOLOGY LTD Luton, England Copyright Reserved - Written Permission to Copy Should be Obtained		
CI	Ckd	
Modification		
Iss	Date	Drn
1	1.95	ACH

**Note 6** Associated Apparatus must be installed in accordance with the National Electrical Code in an enclosure meeting the requirements of ANSI/ISA-S82.

**Note 7** Use FMRC Approved or NRTL Listed dust-ignition proof enclosure(s) appropriate for environmental protection in Class II, Division 2, Groups F and G; Class III Division 2, Hazardous Locations.

**Note 8** For use in Division 2 Hazardous Locations, the MTL4025 must be installed in Factory Mutual Research Corporation Approved Backplanes.

When the MTL4025 is installed in Division 2 Hazardous Locations, a warning label must be prominently affixed near the unit(s) which warns that the MTL4025 must not be removed or inserted unless the area is known to be non-hazardous.

System Certificate No: N/A	Scale N/A
Certifying Authority: Factory Mutual	Sheet 2 of 2
Title Installation Drawing for the MTL4025	SCI-500