




Iss	Date	Drn	Modification
1	12.07	CMB	

MEASUREMENT TECHNOLOGY LTD
 Luton, England
 Copyright Reserved - Written Permission
 to Copy Should be Obtained

Division 2 or Zone 2 Hazardous Location

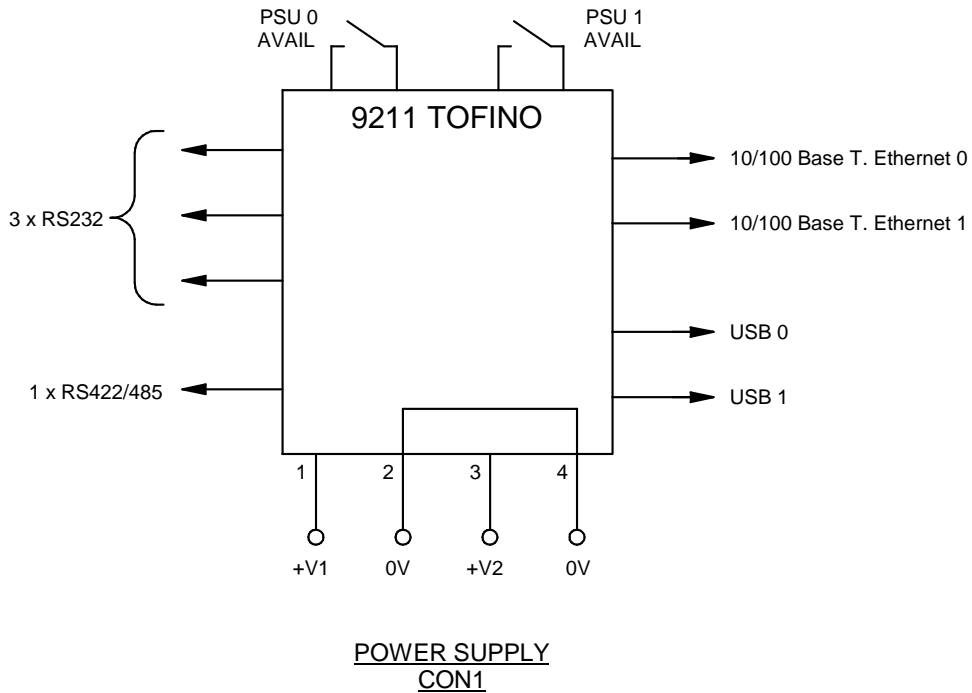

Notes.

1. The 9211 TOFINO must be installed in a suitable equipment enclosure in accordance with ANSI/ISA S82.01 & S82.03, meeting the requirements of IP54.
2. The power Supply connected to CON1, terminals 1 & 3 is 9-32V,dc.
3. The 9211 TOFINO may be mounted in a Class I Division 2, Groups A, B, C and D Hazardous Location or Class I Zone 2 AEx nA IIC Hazardous Location. The permitted Temperature Class is T4 at Ta = 70°C.

System Certificate No: Certifying Authority: FM	Drn. By CMB	Scale N/A
	Drn. Date 12.07	Sheet 1 of 1
Title 9211 TOFINO - Installation		Drg. No. SCI-1032