


Dimensions in mm

Do not Scale

Third Angle Projection

Drg.No.

SCI-78

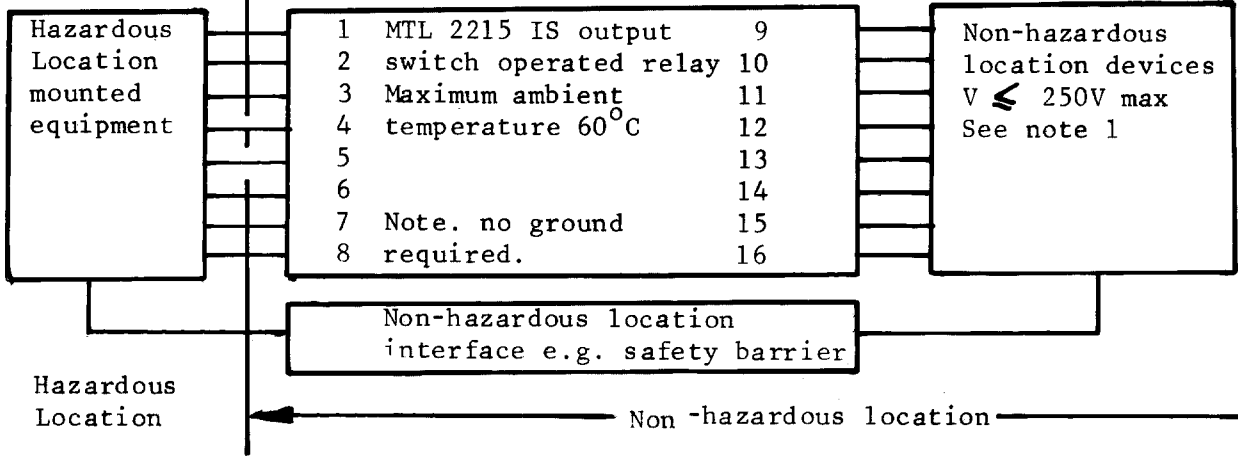

Note. 1 The non-hazardous or control room mounted equipment should not use of generate more than 250 volts r.m.s.

Note. 2 The switch contacts of the MTL 2215 can be connected into any system provided the maximum voltage of the system is less than 75 volts.

Note. 3 The maximum permitted cable parameters will be determined by those of the system into which the MTL 2215 is connected.

Note. 4 For guidance on the installation see ANSI/ISA RP 12.6

MEASUREMENT TECHNOLOGY LTD.
Luton, England
Copyright Reserved - Written Permission to Copy Should be Obtained

Iss. Date / Drawn	1 / 83 / DRG
Modification	2 3

Certifying Authority: Factory Mutual

Used on	Scale
Tolerance unless otherwise stated †	Sheet 1 of 1
Title Installation instructions for the MTL 2215 IS-output switch operated relay	Drg. No. SCI-78