



IECEx Certificate of Conformity

INTERNATIONAL ELECTROTECHNICAL COMMISSION IEC Certification Scheme for Explosive Atmospheres

for rules and details of the IECEx Scheme visit www.iecex.com

Certificate No.: IECEx BAS 08.0030 issue No.: 4

Status: **Current**

Date of Issue: **2016-10-05** Page 1 of 4

Certificate history:

Issue No. 4 (2016-10-5)
Issue No. 3 (2014-3-28)
Issue No. 2 (2011-1-31)
Issue No. 1 (2009-5-6)
Issue No. 0 (2008-5-28)

Applicant: **Eaton Electric Limited**
Great Marlings
Butterfield
Luton
Bedfordshire
LU2 8DL
United Kingdom

Equipment: **MTL5526 Two Channel Switch-operated Relay Output**
Optional accessory:

Type of Protection: **Intrinsic Safety**

Marking: **[Ex ia Ga] IIC**
[Ex ia Da] IIIC
[Ex ia Ma] I
-20°C ≤ Ta ≤ +60°C

Approved for issue on behalf of the IECEx
Certification Body:

R S Sinclair

R S Sinclair

Position:

Technical Manager

Signature:
(for printed version)

Diemling
7110116

Date:

1. This certificate and schedule may only be reproduced in full.
2. This certificate is not transferable and remains the property of the issuing body.
3. The Status and authenticity of this certificate may be verified by visiting the [Official IECEx Website](http://www.iecex.com).

Certificate issued by:

SGS Baseefa Limited
Rockhead Business Park
Staden Lane
Buxton, Derbyshire, SK17 9RZ
United Kingdom

SGS





IECEx Certificate of Conformity

Certificate No.: IECEx BAS 08.0030

Date of Issue: 2016-10-05

Issue No.: 4

Page 2 of 4

Manufacturer: **Eaton Electric Limited**
Great Marlings
Butterfield
Luton
Bedfordshire
LU2 8DL
United Kingdom

Additional Manufacturing location(s):

**MTL Instruments PVT
Limited**
No 3 Old Mahabalipuram
Road
Sholinganallur
Chennai
India

This certificate is issued as verification that a sample(s), representative of production, was assessed and tested and found to comply with the IEC Standard list below and that the manufacturer's quality system, relating to the Ex products covered by this certificate, was assessed and found to comply with the IECEx Quality system requirements. This certificate is granted subject to the conditions as set out in IECEx Scheme Rules, IECEx 02 and Operational Documents as amended.

STANDARDS:

The electrical apparatus and any acceptable variations to it specified in the schedule of this certificate and the identified documents, was found to comply with the following standards:

IEC 60079-0 : 2011 Explosive atmospheres - Part 0: General requirements
Edition: 6.0

IEC 60079-11 : 2011 Explosive atmospheres - Part 11: Equipment protection by intrinsic safety "i"
Edition: 6.0

*This Certificate **does not** indicate compliance with electrical safety and performance requirements other than those expressly included in the Standards listed above.*

TEST & ASSESSMENT REPORTS:

A sample(s) of the equipment listed has successfully met the examination and test requirements as recorded in

Test Report:

GB/BAS/ExTR08.0064/00
GB/BAS/ExTR16.0238/00

GB/BAS/ExTR11.0001/00

GB/BAS/ExTR14.0065/00

Quality Assessment Report:

GB/BAS/QAR06.0022/06

GB/BAS/QAR07.0017/05



IECEx Certificate of Conformity

Certificate No.: IECEx BAS 08.0030

Date of Issue: 2016-10-05

Issue No.: 4

Page 3 of 4

Schedule

EQUIPMENT:

Equipment and systems covered by this certificate are as follows:

The MTL5526 Two Channel Switch-operated Relay Output is designed to enable two separate intrinsically safe circuits to be switched via relay contacts by on/off switches or logic signals from unspecified apparatus in the non-hazardous area. Configuration switches on the apparatus allow the two relay output channels to be alternatively controlled by one input. Each non-hazardous area input can also be loop powered. Two relays provide galvanic isolation between the hazardous and non-hazardous area circuitry.

Each channel of the apparatus comprises a relay, a zener diode and fuse to provide voltage and current limitation to the relay. The above, together with other electronic components are mounted on a printed circuit board and housed in a moulded plastic enclosure. Polarised plugs and sockets are provided for hazardous and non-hazardous area connections. LED indication is provided for the status of each output channel and power-on.

Non-Hazardous Area Terminals 8, 9, 10, 11, 13 & 14)

$U_m = 253V$ r.m.s.

The circuit connected to non-hazardous area terminals 8, 9, 10, 11, 13 & 14 is designed to operate from a d.c. supply voltage of up to 35V.


Hazardous Area Terminals 1 to 3 (Channel 1)

Or

Hazardous Area Terminals 4 to 6 (Channel 2)

U_i	=	30V	U_o	=	0
C_i	=	0	I_o	=	0
L_i	=	0			

CONDITIONS OF CERTIFICATION: NO

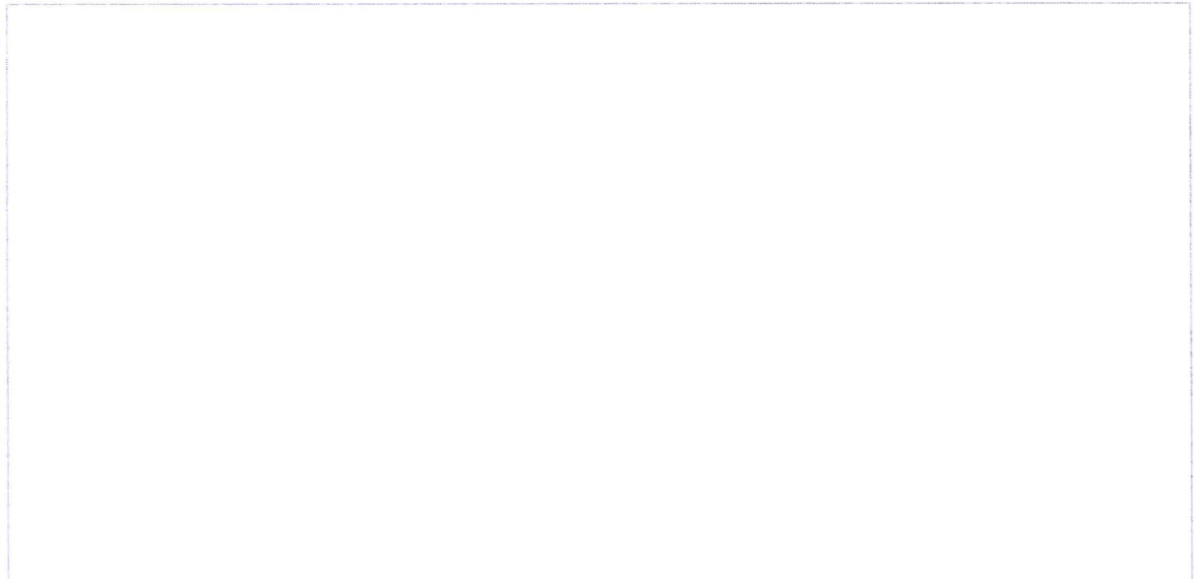



IECEx Certificate of Conformity

Certificate No.: IECEx BAS 08.0030

Date of Issue: 2016-10-05

Issue No.: 4

Page 4 of 4

DETAILS OF CERTIFICATE CHANGES (for issues 1 and above):

Variation 4.1

To permit the manufacturer's name to be changed on the certificate and equipment marking. No other changes are made to the equipment design.

ExTR: GB/BAS/ExTR16.0238/00

File Reference: 16/0371