


MTL LS10N Range

Operating Instructions for LED Lighting - UL Type 4CA SPD

 <p>CAUTION</p>	<p>CAUTION</p> <p>Do not attempt to open or tamper with the SPD in any way as this will compromise performance and will void the warranty.</p> <p>Megger and hi-pot tests will damage this device. Disconnect all power supplying the equipment and isolate the SPD unit before testing.</p> <p>Prior to installation, confirm the SPD is rated for the correct voltage, and frequency equivalent to the application.</p> <p>Risk of Electric Shock – Only intended for installation in accordance with National Electrical Code, ANSI/NFPA-70, Article 398”</p>
---	---

Installation

- 1) Turn off all power supplying this equipment.
- 2) Mount the SPD using the enclosure flanges to a flat surface.
- 3) Connect the wire leads as per the wiring diagrams below.
- 4) For optimal device performance, use shortest length of wire possible and avoid sharp or unnecessary bends.

Product Characteristics

Model	Circuit Type	Service	Modes	In	Frequency	Diagram
LS10N-347-S	Series-Hybrid	120-347V, 5A	L-N, L-G, N,G	3 kA	50/60Hz	A
LS10N-480V-S	Series-Hybrid	277/480V, 5A	L-L, L-G	3 kA	50/60Hz	B
LS12N-347V-P	Parallel-Hybrid	120-347V	L-N, L-G, N-G	3 kA	50/60Hz	C
LS12N-480V-P	Parallel-Hybrid	277/480V	L-L, L-G	3 kA	50/60Hz	D
LS10N-240V-PP	Series-Hybrid	240V split phase, 5A	L-L	3 kA	50/60Hz	E
LS10N-480V-S-PG	Series-Hybrid	480V, 5A	L-G	3 kA	50/60Hz	F

Cable size 12AWG

Short circuit rating of external fuse 200kA(AC), 20kA(DC)

Wiring Diagrams

SERIES CONNECTED SPDs: Units designed to be connected in series with the LED driver for protection of the modes as listed in the table above. Refer to the connection diagrams to ensure that the SPD you have chosen is appropriate for the application it is being installed into. These range versions have internal protection that will disconnect the surge protective components and will not maintain power to the load. If this situation is undesirable for the application, replace the unit with a parallel connected type.

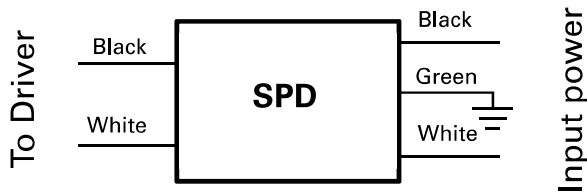


Figure A

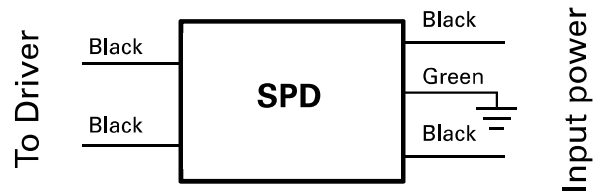


Figure B

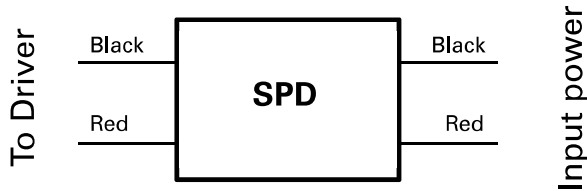


Figure E

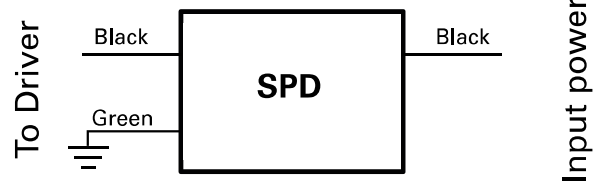


Figure F

PARALLEL CONNECTED SPDs: Units designed to be connected in parallel with the LED driver for protection of the modes as listed in the table above. Refer to the connection diagrams to ensure that the SPD you have chosen is appropriate for the application it is being installed into. These parallel versions have internal protection that will disconnect the surge protective components but will maintain power to the load – now unprotected. If this situation is undesirable for the application, replace the unit with a series connected type. A backup fuse of 7A Class CC type fuse is recommended, if the load current is more than 7A.

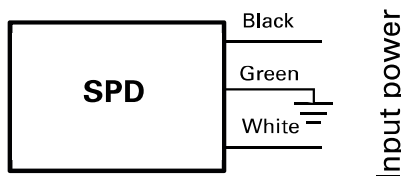


Figure C

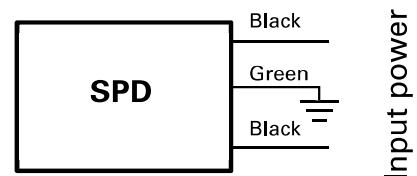


Figure D