Technical data MTL fieldbus networks

November 2020 EPS F104 rev 5

CROUSE-HINDS SERIES

F104

Low-power fieldbus power supply

- Fieldbus power for FOUNDATION™ fieldbus H1 cards
- Low power consumption, for high efficiency in solar-powered applications
- Fully isolated
- Wide input power supply range 10-30V
- DIN-rail mounting
- Supports bussing of input power in the DIN rail
- 13V, 250mA output

The F104 fieldbus power supply is designed to provide power for a single FOUNDATION[™] fieldbus H1 segment. Galvanic isolation, power conditioning and segment termination are incorporated into each F104 module.

The F104 has low current consumption and is ideal for use in solar-powered applications such as instrumentation nodes for remote well-heads. This is achieved by providing a lower output voltage to the fieldbus segment than with conventional fieldbus power supplies. This eliminates unnecessary power dissipation in the fieldbus instruments. The 13V nominal output is nevertheless sufficient to support up to 10 typical instruments on a 200m trunk cable.

Termination of the fieldbus segment is selected using a switch on the module, and is normally enabled, but it may be switched out for those few applications that do not require a terminator at the Fieldbus Power Supply.

For extreme reliability, the module uses passive components for power conditioning and a reliable DC/DC converter to provide galvanic isolation and power regulation. The connectors used for power input and the fieldbus are high quality pluggable types with screw retention. Spring-clamp (-PC) and screw-terminal (-PS) connector versions are supported. **LED indicators show the status** of the module. In normal operation, the green Power LED is lit, showing that there is proper input voltage to the module and the red Fault LED is off. If the fieldbus segment is shorted, or in an over-current condition, the Fault LED blinks. An internal module error is indicated by a steady light on the red Fault LED. The status of the internal terminator switch is also indicated by an illuminated 'T' symbol.

The F104 can be powered from a power supply between 10 to 30V DC; a range that easily accommodates typical 12V and 24V solar-powered battery systems. The incoming power can be applied via a top-mounted connector, which supports onward looping of power wiring, or by using a proprietary plug-in connector on a DIN-rail bussing system.

The F104 module provides galvanic isolation between the input power and the fieldbus segments, as required by the IEC 61158-2 fieldbus standard and the Fieldbus Foundation[™] FF-831 validation test for fieldbus power supplies.

FOUNDATION[™] fieldbus is a trademark of Fieldbus Foundation[™], Austin, Texas.



Eaton Electric Limited, Great Marlings, Butterfield, Luton Beds, LU2 8DL, UK. Tel: + 44 (0)1582 723633 Fax: + 44 (0)1582 422283 E-mail: mtlenquiry@eaton.com www.mtl-inst.com © 2020 Eaton All Bibts Researed

© 2020 Eaton All Rights Reserved Publication No.EPS F104 rev 5 November 2020



F104

November 2020

SPECIFICATION

Location of equipment

Safe Area, Class I Div 2 Groups ABCD T4, or Class I Zone 2 IIC T4 hazardous area IEC Zone 2 IIC T4 or Zone 22 hazardous area

INPUT

Input voltage

10.0 – 30.0V DC

Reverse polarity protection Yes

103

Current consumption see Input Current graph

Power dissipation

see Power Dissipation graph

Note: modules are capable of operating at full load without spacing

OUTPUT

Number of Channels

One (1)

Voltage

13.0 – 14.0V DC

Design Current

0 to 250mA

Segment Current Limit > 280mA

Minimum Load

10mA

Isolation

Fieldbus to input power: Tested at 500V ACrms in accordance with $\mathsf{FF}\text{-}831$

ELECTRICAL CONNECTIONS

Fieldbus wiring (host and field)

Screw-secured, 3-way pluggable connectors in screw terminal or spring clamp version, 0.14 to 2.5mm²

Power input

Screw-secured, 4-way pluggable connector in screw terminal or spring clamp version, 0.14 to 2.5mm² (see diagram)

DIN-rail power bussing option

Proprietary connection system - see Ordering Information **Fieldbus terminator**

100W, switchable

MECHANICAL

Mounting method

Integrated fixings for vertical 'Top hat' DIN-rail, 35mm x 7.5mm to EN50022

Housing material

Polycarbonate

Tagging strip

To accept paper legend

ENVIRONMENTAL

Ambient temperature

Operating: -40°C to +70°C*

Storage: -40°C to +85°C

* fitted on horizontal DIN-rail mounted on a vertical plane **Relative humidity**

<95%, non-condensing


Ingress protection

IP20 to BS EN60529 (Additional protection by means of enclosure)

F104 - BLOCK DIAGRAM

(showing interconnection scheme)

The above diagram shows a basic illustration of how the F104 To field devices

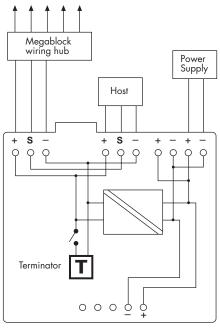

DIN-rail bus

is wired. For detailed wiring information, see the installation instructions.


PHYSICAL NETWORKS

IEC61158-2 ISA-S50.02 Part 2-1992 Foundation™ fieldbus H1 Profibus PA

LED INDICATORS


| | OFF | ON | Flashing |
|-------------------------------|------------------------------------|--------------------------------------|-------------------------------------|
| Power (green) | Power fail or internal fault | Power OK | _ |
| Fault (red) | Normal | Internal error, replace module | Output current limit exceeded |
| Terminator (white 'T') | Terminator disabled | Terminator enabled | _ |


F104 PARAMETERS (typical)

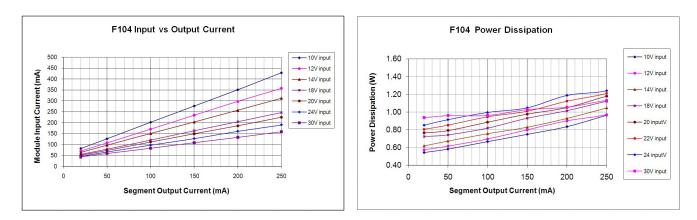

F104 DIMENSIONS (mm)

(shown with screw-clamp connectors)

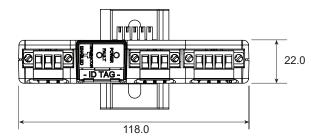

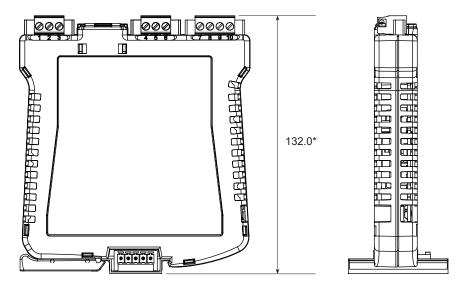


* + 5mm with spring clamp connectors

F104

November 2020

ORDERING INFORMATION

| PART No. | Description |
|----------|--|
| F104-PS | Fieldbus Power Supply (13.0V, 250mA) pluggable screw-terminal connectors |
| F104-PC | Fieldbus Power Supply (13.0V, 250mA) pluggable spring-clamp connectors |
| PBUS01 | Power Bus DIN-rail connectors, pack of 5 |
| PBUS02 | Power Bus DIN-rail input plug and socket set |
| PBUS03 | DIN-rail mounted strain relief clamps, pack of 2 |

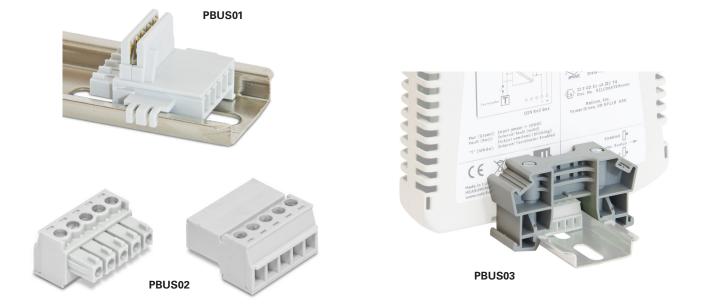

APPROVALS - for the latest certification information visit www.mtl-inst.com/certificates

| Region (Authority) | Standard | Certificate | Approved for | Ratings |
|------------------------|--|-----------------|--|---|
| EU (Relcom) | EN61326-1:2013 | | Class A Industrial Locations | CE |
| (Fieldbus Foundation™) | FF-831 | PS072902 | _ | Power Supply Type 132 |
| US (FM) | 3600: 2011 3611: 2004 3810: 2005 | 3035979 | Class I, Div 2, ABCD, T4 Class I, Zone 2, IIC, T4 | NI/I/2/ABCD/T4 Ta=70°C I/2/IIC/T4 Ta=70°C |
| Canada (FM) | CAN/CSA - E60079-15: 2002 C22.2 No. 213: 2004 C22.2 No. 1010.1: 2004 | 3035979C | Class I, Div 2, ABCD, T4 Class I, Zone 2, IIC, T4 | NI/I/2/ABCD/T4 Ta=70°C Ex nA nL IIC T4 Ta=70°C |
| ATEX (Relcom) | EN 60079-0:2012+A11:2013 EN 60079-15:2010 | RELC09ATEX1008X | Zone 2 IIC T4 | &ં∂ II 3 G Ex nA IIC T4 Gc |



Eaton Electric Limited, Great Marlings, Butterfield, Luton Beds, LU2 8DL, UK. Tel: + 44 (0)1582 723633 Fax: + 44 (0)1582 422283 E-mail: mtlenquiry@eaton.com www.mtl-inst.com

© 2020 Eaton All Rights Reserved Publication No.EPS F104 rev 5 191120 November 2020 EUROPE (EMEA): +44 (0)1582 723633 mtlenquiry@eaton.com

THE AMERICAS: +1 800 835 7075 mtl-us-info@eaton.com

ASIA-PACIFIC: +65 6 645 9888 sales.mtlsing@eaton.com The given data is only intended as a product description and should not be regarded as a legal warranty of properties or guarantee. In the interest of further technical developments, we reserve the right to make design changes.